


-15kV TOF: -9245 v  
 -3.6kV MCP: -2578 v  
 -2.4kV MCP: -1579 v  
 Input Cur: 302 ma  
 RPA max: 237 v  
 Mirror max: 238 v

Mon Sep 25 10:49:17 2006

## TIDE Direct Events

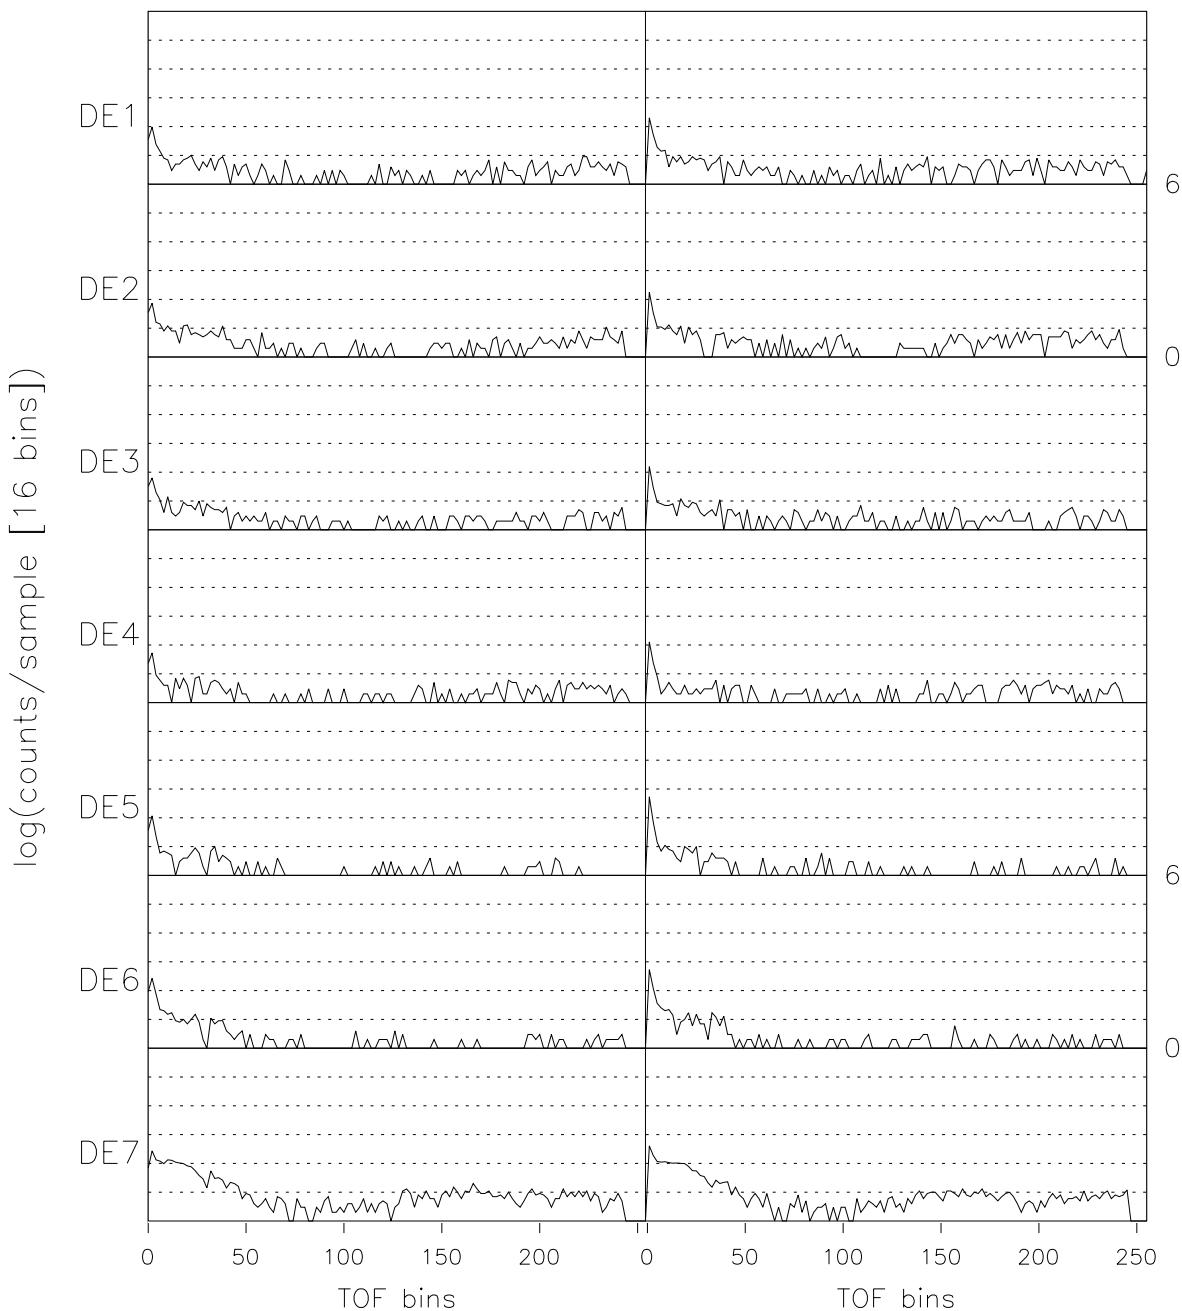

reported: 09-03-96 16:16:41 UT

reported: 09-03-96 16:19:53 UT

file: /export/data/tide/nrt/96090301.dat

-15kV TOF: -9181 v

-3.6kV MCP: -2578 v

-2.4kV MCP: -1579 v

Input Cur: 300 ma

RPA max: 237 v

Mirror max: 238 v